
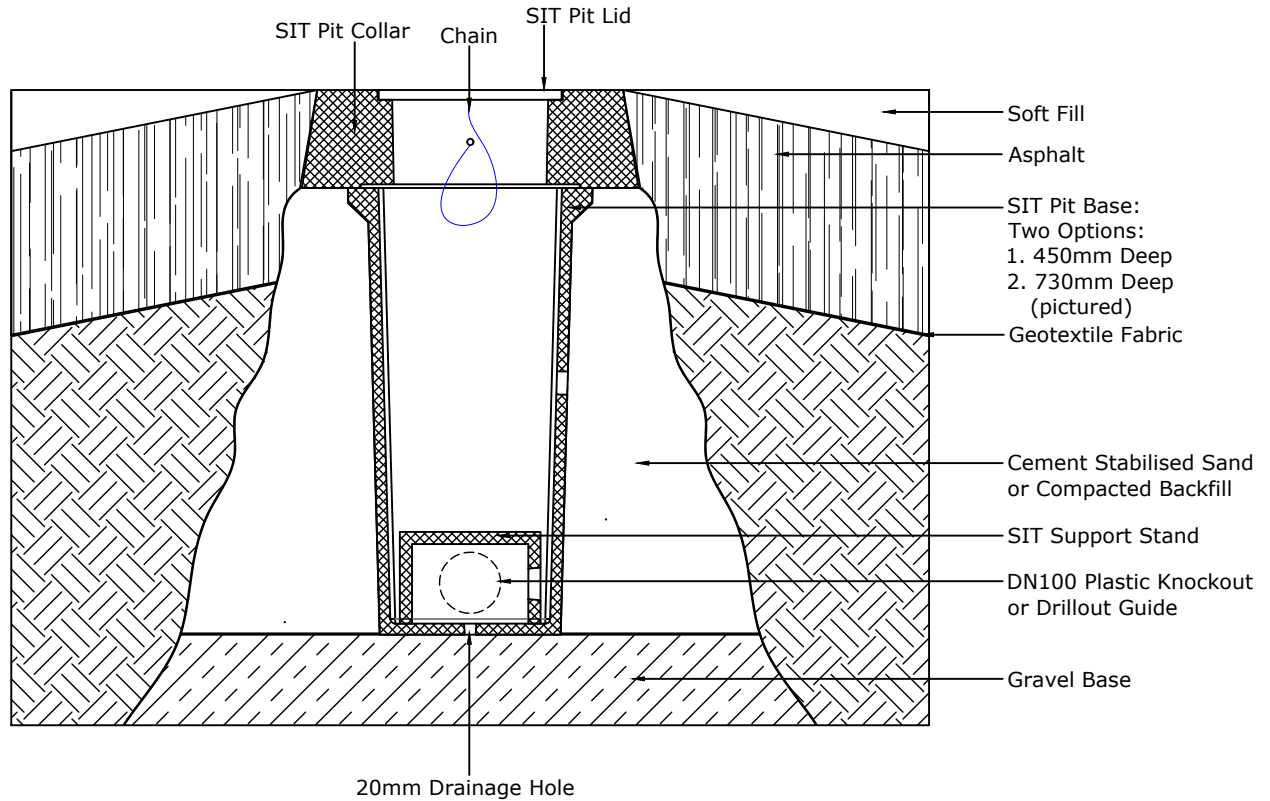


ACO CABLEMATE®	POLYCRETE® PITS INSTALLATION DRAWING	
DWG# IC009 www.acoaus.com.au	SIT Pit Assembly	
General Delethalisation Detail		



NOTES:

1. Specific site conditions will require a modification to these general details.
2. It is the customer's responsibility to ensure effective delethalisation occurs and the pit structure is protected from undue stress.
3. If in doubt, seek engineering advice.

ACO CABLEMATE®	POLYCRETE® PITS SPECIFICATION CLAUSE	ACO Pty Ltd 134-140 Old Bathurst Road Emu Plains NSW 2750 Tel: +61 2 4747 4000 Fax: +61 2 4747 4040 E: technical@acoaus.com.au
DRWG# IC009 www.acoaus.com.au	SIT Pit Assembly	

The Series Isolation Transformer (SIT) pit comprises a polymer concrete pit (part no.....) and galvanised lid (part no.....). A polymer concrete stand (part no. 142319) is also available to support series isolation transformer above the base of the pit. The lid and collar is rated to 25 tonnes.

All materials and components within the scope of the system shall be obtained from ACO.