
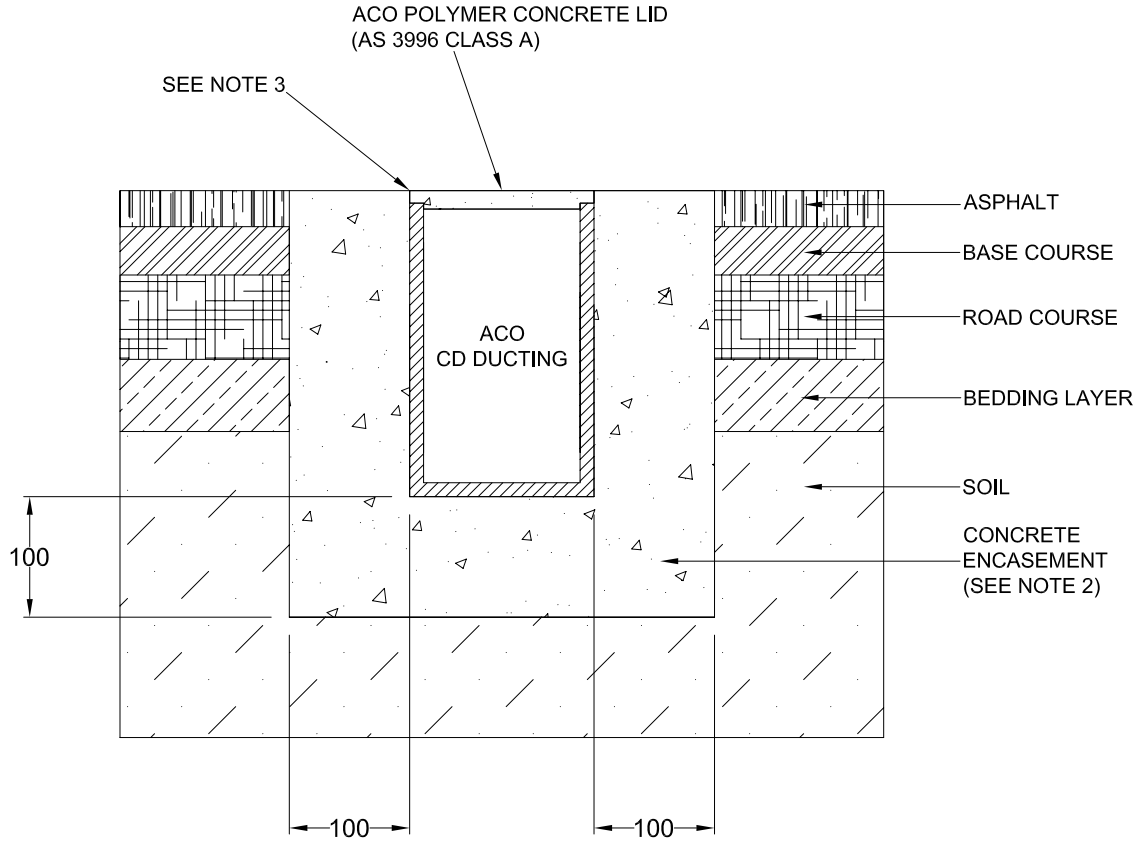


<b>ACO CABLEMATE®</b>	<b>CABLE DUCTING INSTALLATION DRAWING</b>	
DRWG# XCCD-AA www.acoaus.com.au	<b>With Polymer Concrete Lid</b>	
<b>Asphalt: For 330kg Nominal Wheel Load</b>		



- NOTES:**
1. Specific site conditions may require an increase in these dimensions or reinforcement. It is the customer's responsibility to ensure the concrete encasement is designed for the application. *Engineering advice may be required.*
  2. A minimum concrete strength of 25MPa is recommended. The concrete should be vibrated to eliminate air pockets.
  3. The finished level of the concrete encasement must be flush with the top of the lid.
  4. Refer to ACO's latest installation instructions for complete details.

<b>ACO CABLEMATE®</b>	<b>CABLE DUCTING SPECIFICATION CLAUSE</b>	ACO Polcrete Pty Ltd 134-140 Old Bathurst Road Emu Plains NSW 2750 Tel: +61 2 4747 4000 Fax: +61 2 4747 4040 E: technical@acoaus.com.au
DRWG# XCCD-AA www.acoaus.com.au	<b>With Polymer Concrete Lid</b>	

The surface cable ducting system (for a nominal wheel load of 330kg) with *clear opening(s) of .....* shall be **ACO Cablemate® CD.....** ducting channel(s) and *part no.(s) .....* with Polymer Concrete lid(s) and *part no.(s) .....*

All materials and components within the scope of this system shall be obtained from ACO Polcrete Pty Ltd and the work shall be carried out as specified in accordance with the manufacturer installation recommendations.